


Figure 2/Type V retaining wall with level backfill

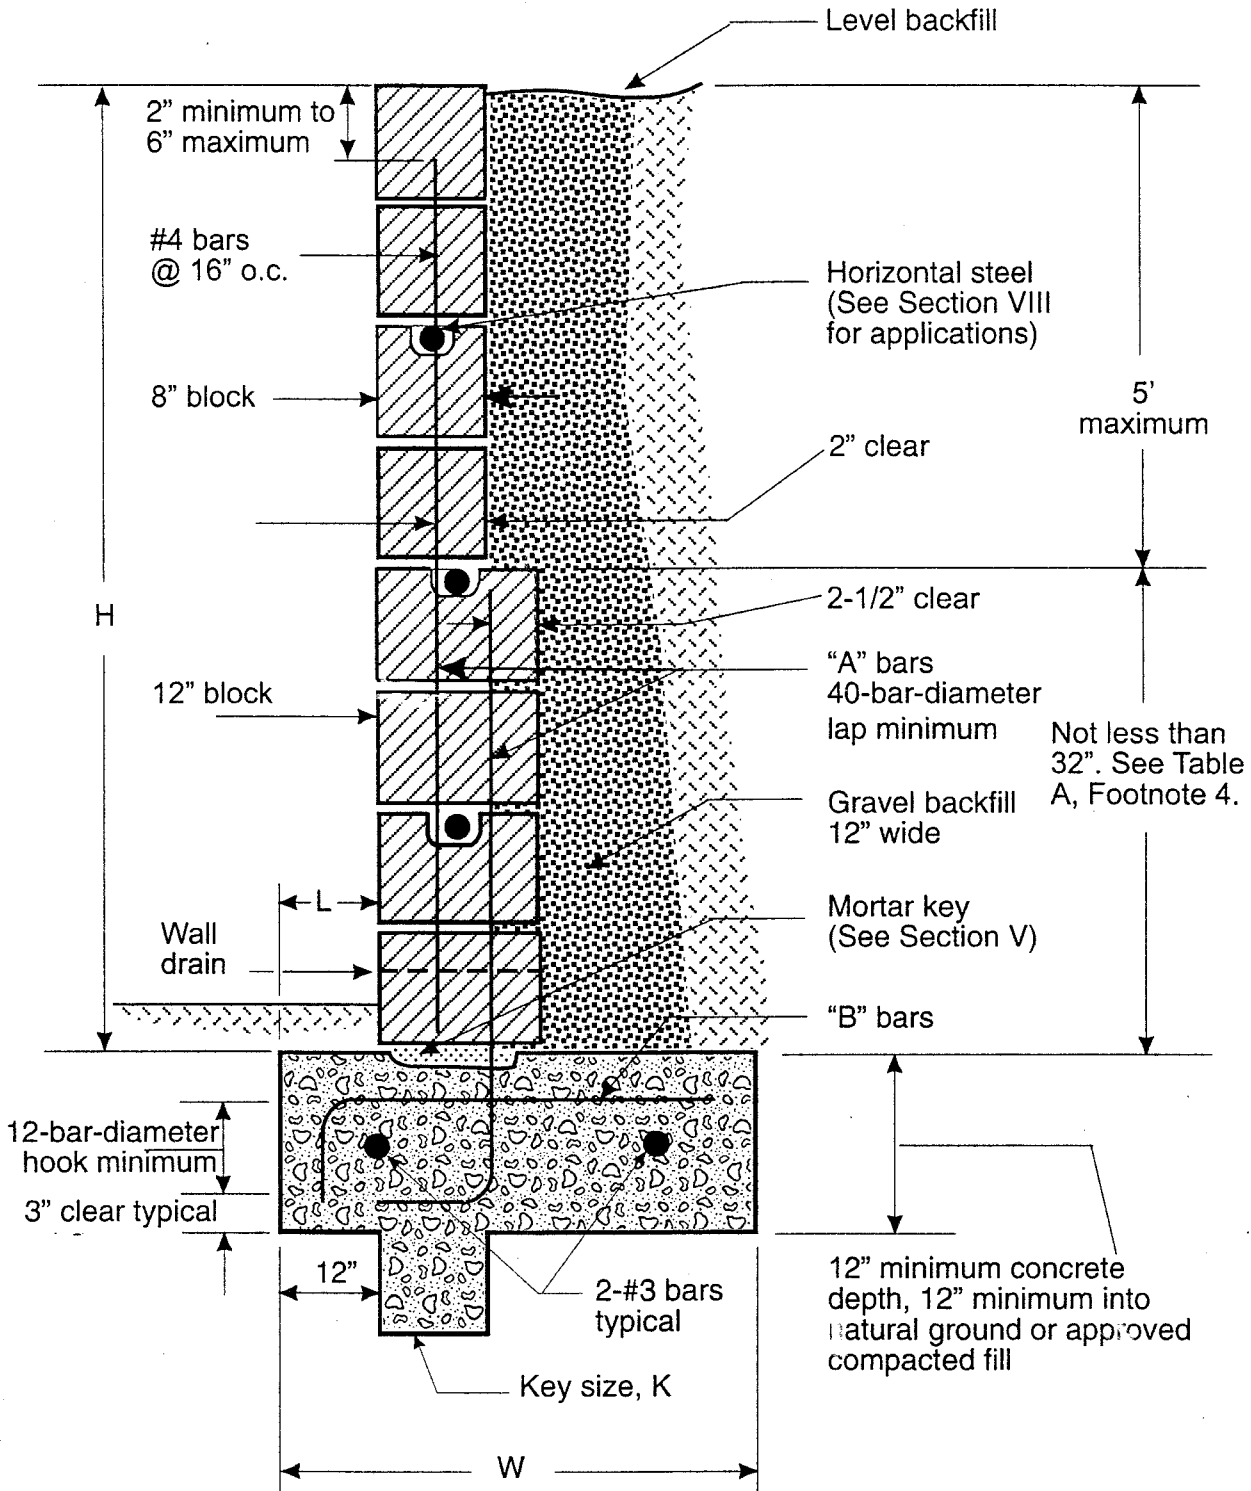

Note: A minimum of 7 feet must be provided horizontally from the toe of the footing to daylight where the ground slopes away from the base of the wall.